


Corn Silage Statistics

175 Samples




SP (Microbial) % CP

SP (microbial) %CP	
Average	51.98
StDev	11.66
Normal Min	28.67
Normal Max	75.30
Count	174

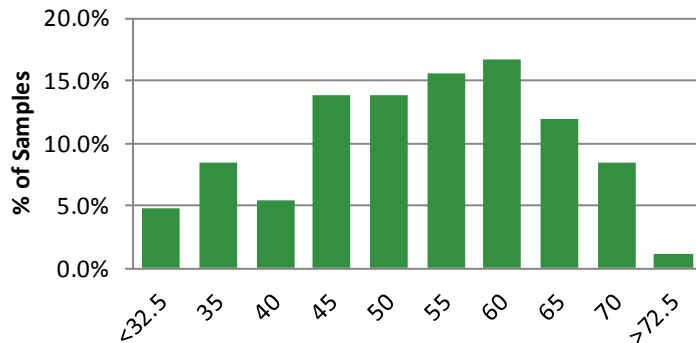


aPartitioning Factor

aPartitioning Factor	
Average	3.69
StDev	0.85
Normal Min	1.98
Normal Max	5.39
Count	174

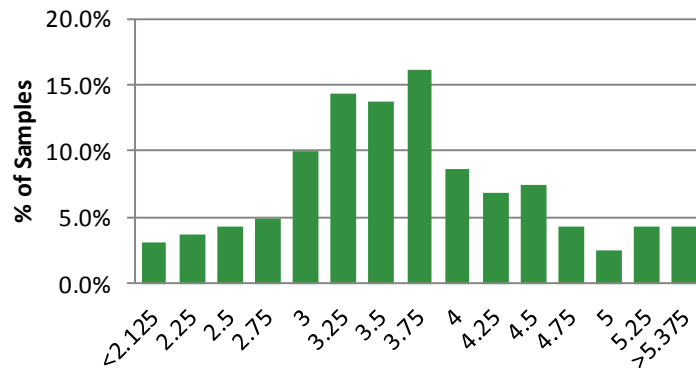


aOMD

aOMD %DM	
Average	51.62
StDev	6.71
Normal Min	38.19
Normal Max	65.05
Count	174

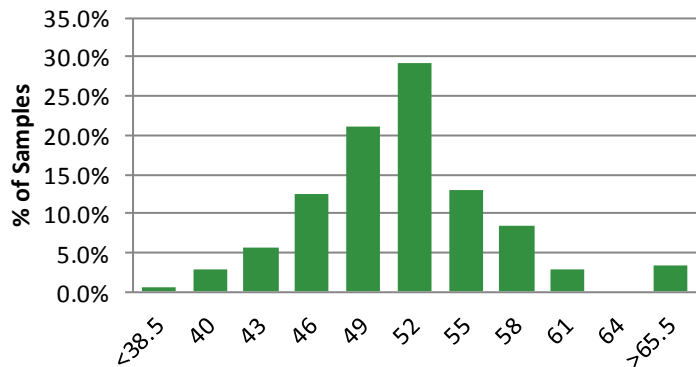

MBP

MBP (mg/g)	
Average	116.30
StDev	28.45
Normal Min	59.39
Normal Max	173.21
Count	173

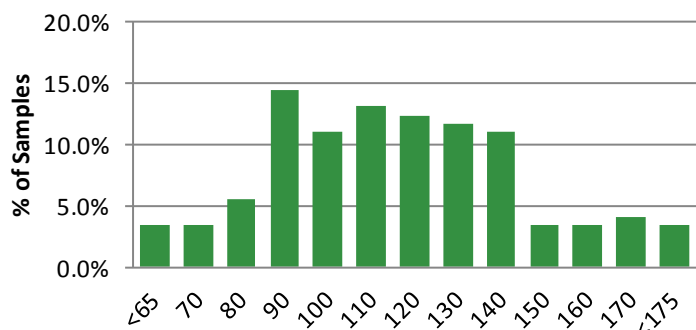


Corn Silage Statistics

175 Samples




C:B1 Kd %/hr

C:B1 Kd %/hr	
Average	16.85
StDev	4.89
Normal Min	7.39
Normal Max	26.64
Count	173

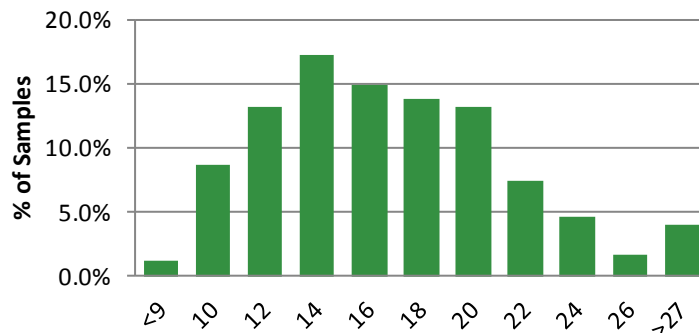


C:B3 Kd %/hr

C:B3 Kd %/hr	
Average	4.47
StDev	1.02
Normal Min	2.43
Normal Max	6.51
Count	174

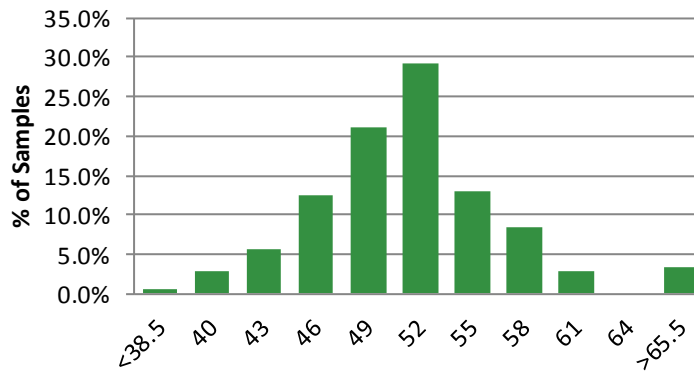

Fast Pool ml gas

Fast Pool ml gas	
Average	28.44
StDev	6.59
Normal Min	16.43
Normal Max	41.63
Count	174

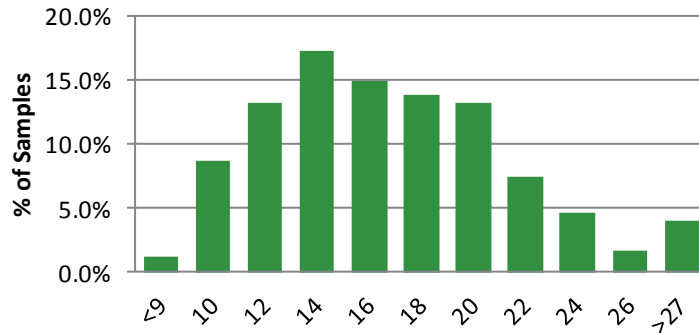

Slow Pool ml gas

Slow Pool ml gas	
Average	40.05
StDev	9.92
Normal Min	22.86
Normal Max	59.89
Count	174

